


Updating the ZOOM Nitro® Timer to Seconds Only

The following instructions explain how to update your ZOOM Nitro Timer from Minutes & Seconds to Seconds Only.


How to Update the ZOOM Nitro Timer to Seconds Only

1. Click on the hamburger icon in the top left corner.

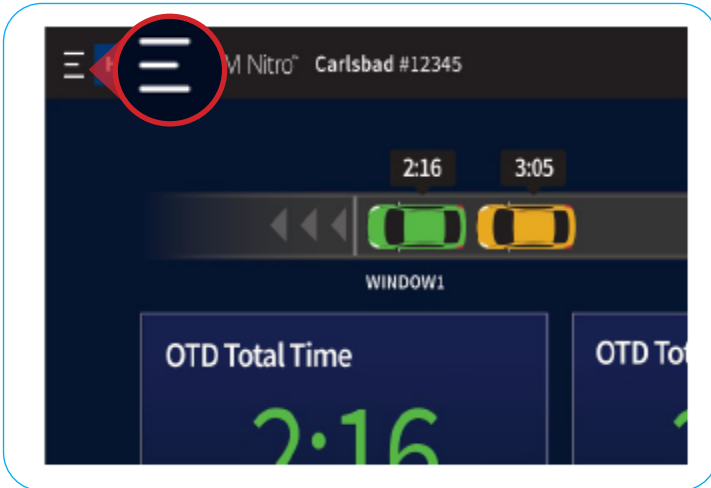


2. On the **Login** page, enter your password and click **Log in**.


Note: To obtain a temporary password, contact HME Tech Support at **800.848.4468** or email support@hme.com

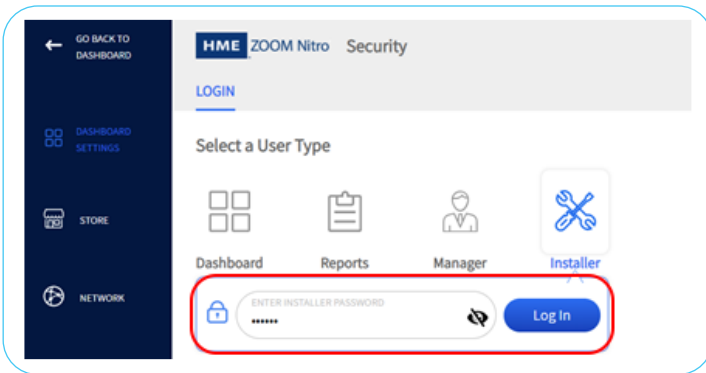


3. Click on **Store** in the navigation bar on the left.

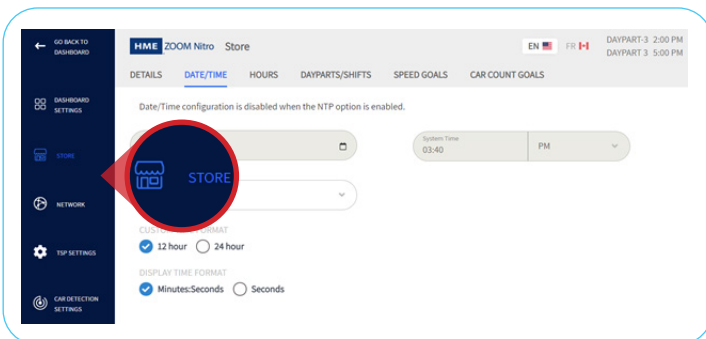

- In the top navigation bar, click on **Date/Time**.
- Under the **Display Time Format** section, click on **Seconds**.
- Click on **Save**.

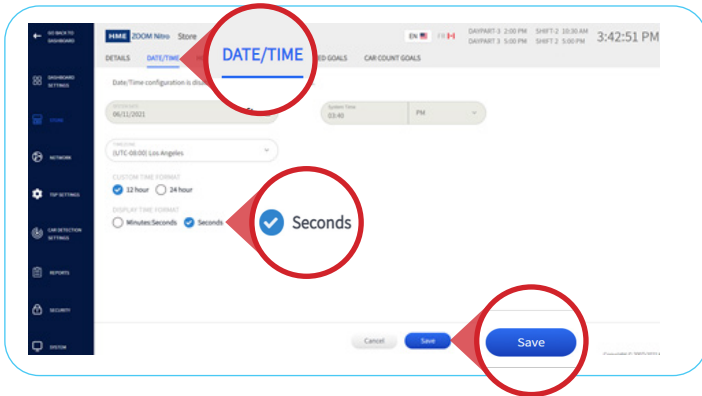

- To return to the ZOOM Nitro Timer dashboard, click on **Go Back to Dashboard** in the top left.

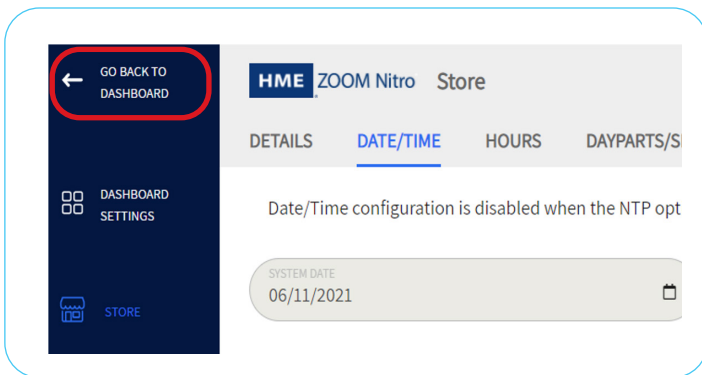


- The ZOOM Nitro Timer dashboard will now be updated to display seconds only.




How to Update Additional Devices to Seconds Only With a Pre-Configured Device on HME CLOUD™

1. On the HME CLOUD Welcome Page, click on **Settings** in the top navigation bar.

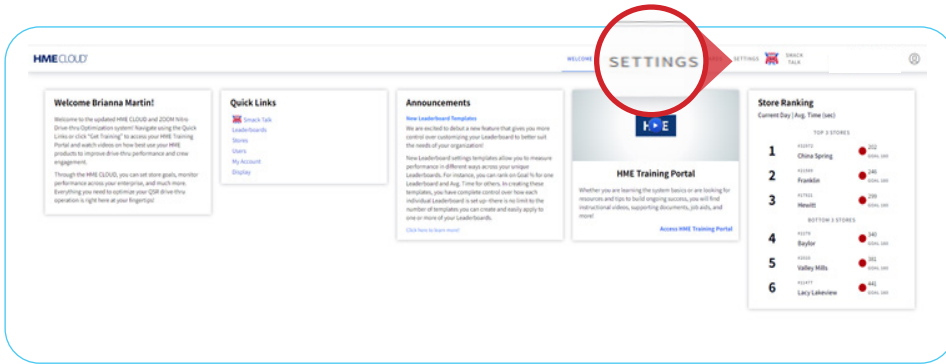


2. In the navigation bar at the top left, click the **Apply Device Settings** tab.


3. Click on **Create New Task**.

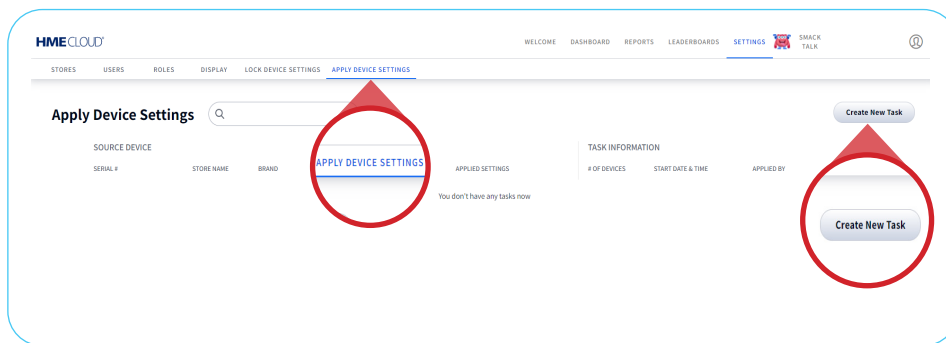

4. Enter the **Device Serial Number**.

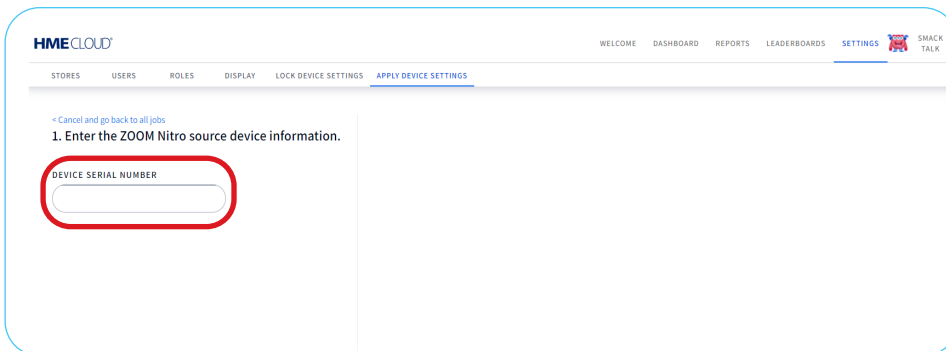

5. Click on **All Settings** or **Groups of Settings** based on your preferences under **Choose Device Settings to Apply**.
6. Check the box next to the store(s) you would like the settings applied to.
7. Click on **Apply Settings**.

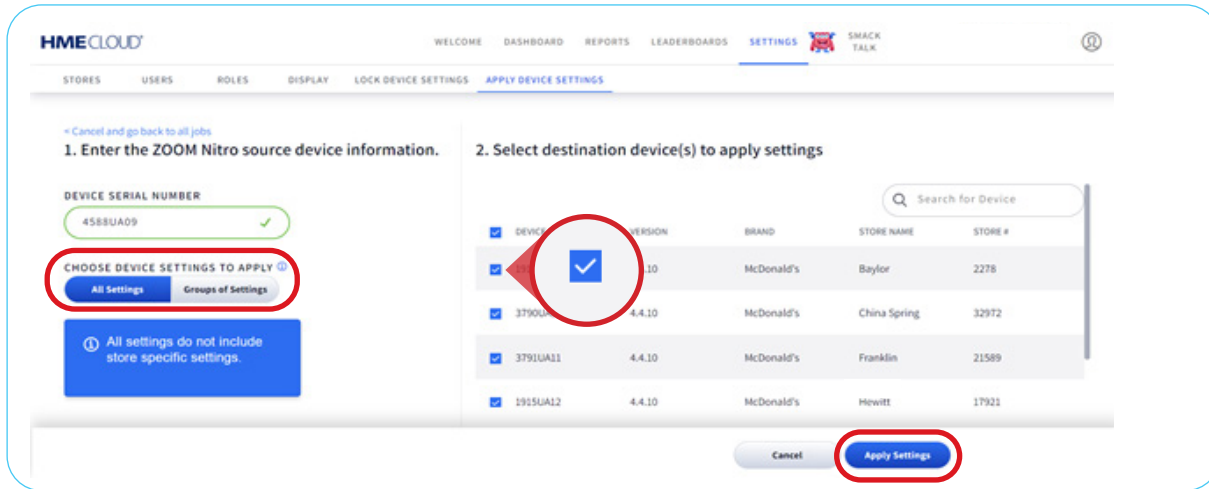

For help, call 800.848.4468 (options 1,2, and 3) or email: support@hme.com

4 of 4

HME Training Portal

Find instructional videos, supporting documents, and other guides.

www.hme.com/training
Scan to Visit ▶

